

COMMON RELATED TOPICS

Stormwater and SPCC Training – Annual Refresher

January 23, 2018

Katherine Yarberry, PE

Can you help with.....?



- NetDMR
 - *Reporting of individual and some general NPDES permit data*
- Registered Storage Tanks (RST)
 - *Aboveground Storage Tanks ASTs*

Picture Source: clipartpanda.com

Central Data Exchange (CDX)




CDX Central Data Exchange

 [Contact Us](#)

Logged in as KYARBERRY@HARBORENV.COM ([Log out](#))

[MyCDX](#) [Inbox](#) [My Profile](#) [Submission History](#)

Services

Status	Program Service Name	Role
	eDisclosure: Voluntary Disclosure System	Disclose/Certify
	NDMR-AR: NetDMR: Arkansas DEQ	Data Provider
	TRIMEweb: Toxic Release Inventory Made Easy Web	TRI-MEweb

Alerts

TRIMEweb: The TRI-MEweb application will be updated for RY 2017 soon and will be released in the first week of February, 2018.

January 10 2018

CDX Service Availability

[See the status for all program services](#)

News and Updates

No news/updates.


[Add Program Service](#)

[Manage Your Program Services](#)

- Used for reporting multiple USEPA programs
- NetDMR migrated to CDX in 2017

NetDMR

Home | My Account | Request Access | Help | Logout User: kyarberry@harborenv.com, Data Provider



Arkansas DEQ


Search
All DMRs & CORs

Unscheduled DMRs
Unscheduled DMRs

Import DMRs
Perform Import
Check Results

Update NODI
Check Results

Download
Blank DMR Form

 Session Lockout Timer: 29:38

Search: All DMRs & CORs

All DMRs & Copies of Record (CORs)

Use the following fields to search for DMRs and CORs. Leaving a field blank will instruct NetDMR not to filter on that field.



Permit ID: All Update

Facility: All Update

Note: The **Update** buttons above for Permit ID and Facility will update the Permitted Feature and Discharge selection boxes below.

Permitted Feature: All Update

Discharge: All

Monitoring Period End Date Range:   (mm/dd/yyyy)

Edited or Submitted By: All

Status: Ready for Data Entry All

Last 10 Logins

1/18/18	4:48 PM	-
12/21/17	9:22 AM	-
12/21/17	8:45 AM	-
11/22/17	4:55 PM	-
11/22/17	3:28 PM	-
11/22/17	3:21 PM	-
11/17/17	8:23 AM	-
10/25/17	3:40 PM	-
10/24/17	1:14 PM	-
10/24/17	10:19 AM	-

- Use to submit analytical data or other required scheduled reports to ADEQ
- Only Individual (AR00) and General (ARG) permits at this time

Old Form is Still There!

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if Different) NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) Form Approved OMB No. 2040-0004

DISCHARGE MONITORING REPORT (DMR)

NAME ADDRESS

PERMIT NUMBER DISCHARGE NUMBER

FACILITY LOCATION

MONITORING PERIOD					
FROM			TO		
YEAR	MO	DAY	YEAR	MO	DAY

NOTE: Read instructions before

PARAMETER	X	QUANTITY OR LOADING			QUALITY OR CONCENTRATION				NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS			
	SAMPLE										
	PERMIT REQUIREMENT										
	SAMPLE										
	PERMIT REQUIREMENT										
	SAMPLE										
	PERMIT REQUIREMENT										
	SAMPLE										
	PERMIT REQUIREMENT										
	SAMPLE										
	PERMIT REQUIREMENT										
	SAMPLE										
	PERMIT REQUIREMENT										

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.	TELEPHONE		DATE	
TYPED OR PRINTED		SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT	AREA	NUMBER	YEAR

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

- If you get nostalgic for the old days, you can download the paper DMR form
- Use it to draft your report, but cannot be used as the sole submittal device
 - *Can attach to DMR, if you want*



No Data Indicator (NODI) Codes

NODI Code	NODI Description	Violation?
NODI = 1	Wrong Flow	Violation
NODI = 2	Operation Shutdown	
NODI = 3	Special Report Attached	
NODI = 4	Discharge to Lagoon/Groundwater	
NODI = 5	Frozen Conditions	
NODI = 7	No Influent	
NODI = 8	Other (See Comments)	Violation
NODI = 9	Conditional Monitoring - Not Required This Period	
NODI = A	General Permit Exemption	
NODI = B	Below Detection Limit/No Detection	
NODI = C	No Discharge	
NODI = D	Lost Sample/Data Not Available	Violation
NODI = E	Analysis Not Conducted/No Sample	Violation
NODI = F	Insufficient Flow for Sampling	

NODI Code	NODI Description	Violation?
NODI = G	Sampling Equipment Failure	Violation
NODI = H	Invalid Test	Violation
NODI = I	Land Applied	
NODI = J	Recycled - Water-Closed System	
NODI = K	Natural Disaster	
NODI = L	DMR Received but not Entered	Violation
NODI = M	Laboratory Error	Violation
NODI = N	Not Constructed	
NODI = Q	Not Quantifiable	
NODI = R	Administratively Resolved	
NODI = S	Fire Conditions	
NODI = V	Weather Related	
NODI = W	Dry Lysimeter/Well	
NODI = X	Parameter/Value Not Reported	Violation

No Data Indicator (NODI) Codes

Whole Form

No Data Indicator (NODI)
Form NODI:

Parameter		NODI List	Quantity or Loading			Value 1
Code ▲	Name		Value 1	Value 2	Units	
		Smpl.				
		Req.				
		NODI				

Whole Parameter

Single Value


NODI:

ADEQ NetDMR Contact Information

- Richard Healey, Enforcement Branch Manager: 501-682-0640
 - healeyr@adeq.state.ar.us
- General NetDMR Assistance: 501-682-0624
 - netdmr@adeq.state.ar.us
- David Ramsey, ICIS Program Coordinator: 501-682-0615
 - ramsey@adeq.state.ar.us

Registered Storage Tanks (RST)

- Underground Storage Tanks (UST) – Remember: exempt from SPCC if subject to UST Regs (40 CFR 280)
- Aboveground Storage Tanks (AST)
 - *Register with ADEQ*
 - *Register with Arkansas State Police (State Fire Marshal)*

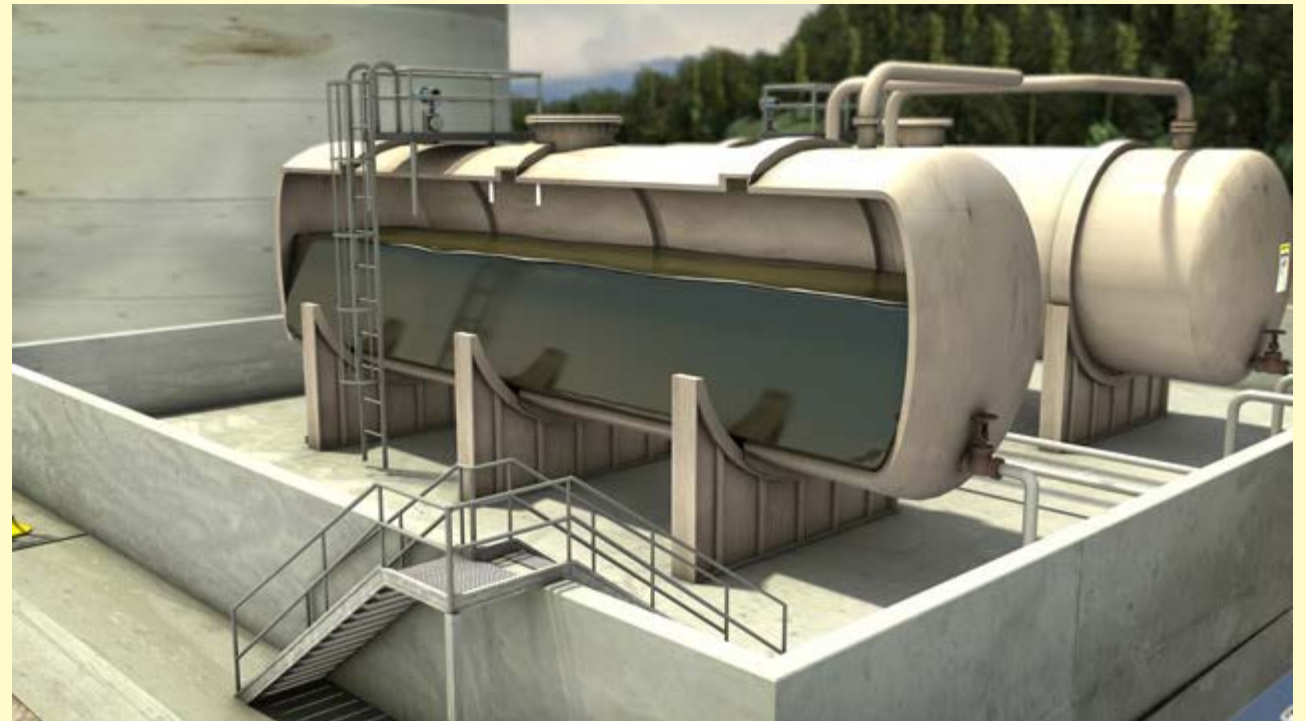

Picture Source: convergencetraining.com

Aboveground Storage Tanks (AST)

- 25 gallon spill threshold:

APC&EC Reg.
12.108(B)(1)

plus

40 CFR 280,
Subpart E

- Technically:
petroleum-based
1,320 gal

Reg.12.108 Notice Requirements

(A) The Department must be given timely notice of any release as required by 40 C.F.R. § 280, Subpart E.

(B)(1) The requirement for giving timely notice of a release from an aboveground storage tank system shall be the same as that for underground storage tank systems.

(2) An owner or operator is required to give notice of a release from an aboveground storage tank system if the amount of the release equals or exceeds existing reporting limits in any other applicable federal or state statutes or regulations.

(C)(1) To ensure timely notice of a release or suspected release from a storage tank system is received by the Department, an owner or operator must follow up a verbal notice to the Department with written notice of the release or suspected release within three (3) business days following the date of the initial verbal notice.

(2) Written notice may be submitted in, but is not limited to, the following forms: facsimile, electronic mail, U. S. mail, hand-written correspondence or by another form as may be provided by the Department.